



UNIVERSITI PUTRA MALAYSIA

**DEVELOPMENT OF SIMULATION PROGRAM FOR
THERMAL ENERGY STORAGE INTEGRATED
DISTRICT COOLING SYSTEM**

AMIR IHSAN ABD. SALAM

FK 2002 62

**DEVELOPMENT OF SIMULATION PROGRAM
FOR THERMAL ENERGY STORAGE INTEGRATED
DISTRICT COOLING SYSTEM**

By

AMIR IHSAN ABD. SALAM

**Thesis Submitted to the School of Graduate Studies, Universiti Putra Malaysia,
in Fulfilment of the Requirements for the Degree of Master of Science**

November 2002



**DEVELOPMENT OF SIMULATION PROGRAM
FOR THERMAL ENERGY STORAGE INTEGRATED
DISTRICT COOLING SYSTEM**

AMIR IHSAN ABD. SALAM

**MASTER OF SCIENCE
UNIVERSITI PUTRA MALAYSIA**

2002



DEDICATION

I would like to record my deepest appreciation to my parents Hj. Abd. Salam Hj. Mohd. Zain and Hjh. Noor Aini Mohamed for their infinitive support. To my loving wife, Sharifah Intan Khursiah Syed Husin, for her encouragement and getting through my disposition during the whole writing process. My lovely kids, Qurratul Ain and Aminatul Adilah for the laughter that enlighten the family. Also, to my big family members who are always there for me.

Abstract of thesis presented to the Senate of Universiti Putra Malaysia in fulfillment of the requirements for the degree of Master of Science

**DEVELOPMENT OF SIMULATION PROGRAM
FOR THERMAL ENERGY STORAGE
INTEGRATED DISTRICT COOLING SYSTEM**

By

AMIR IHSAN BIN ABD. SALAM

November 2002

Chairman: Associate Professor Megat Hamdan Megat Ahmad, Ph.D.

Faculty: Faculty of Engineering

Awareness on the environment and significant benefit to the customer has lead to the growth of Thermal Energy Storage (TES) application in Malaysia. Most of them are implemented in medium to large chilled water manufacturing facility that cooled multiple buildings in a widespread area or integrated in a District Cooling System (DCS). For encapsulated ice method, the difference in the amount of ice supplied to supplement the chilled water generated during peak hours plays major role in ascertaining the result of electricity bill savings and therefore, payback period. Based on actual implementation in Cyberjaya, Selangor, a simple simulation program of TES integrated DCS is created to study the impact on the electricity bill savings,

conventional system. Varying the percentage of ice supply, application to cooling capacity of 500 RT, 1000 RT, 1500 RT with and without base load, on different tariff rates are calculated. It shows that integration of smallest percentage of TES is most feasible in terms of payback period and electricity consumption. However, the amount of savings is small. As the ice making process operates at lower temperature, there is also penalty on energy consumption. On tariff imposed, the acceptable range for base load and percentage of ice supply that is feasible are identified while most of the rates in no base condition qualify to entitlement of payback period under five years. The parameters whereby TES integrated DCS are not advisable are also acknowledged.

Abstrak tesis yang dikemukakan kepada Senat Universiti Putra Malaysia sebagai memenuhi keperluan untuk Ijazah Master Sains

**PEMBANGUNAN ATURCARA SIMULASI BAGI SISTEM PENYEJUKAN
DAERAH DAN PENYIMPANAN TENAGA HABA SEPADU**

Oleh

AMIR IHSAN BIN ABD. SALAM

November 2002

Pengerusi: Profesor Madya Megat Hamdan Megat Ahmad, Ph.D.

Fakulti: Kejuruteraan

Kesedaran terhadap alam sekitar dan manfaat yang diperolehi pengguna telah menerajui peningkatan dalam penggunaan Penyimpanan Tenaga Haba di Malaysia. Kebanyakan aplikasi tersebut melibatkan pusat penjanaan air dingin bersaiz sederhana hingga besar bagi menyejukkan beberapa buah bangunan dalam satu kawasan yang luas atau disepadukan ke dalam Sistem Penyejukan Daerah. Bagi kaedah ais berkapsul, perbezaan di antara jumlah ais yang dibekalkan bagi mengatasi kekurangan air dingin yang dijana semasa waktu puncak memainkan peranan penting dalam menentukan hasil penjimatan bil elektrik dan seterusnya tempoh pulangan balik. Berdasarkan perlaksanaan sebenar di Cyberjaya, Selangor, satu kaedah aturcara mudah bagi mengkaji kesan Penyimpanan Tenaga Haba dan Sistem Penyejukan

Daerah Sepadu terhadap penjimatan bil elektrik, tempoh pulangan balik, guna tenaga dan penggunaan elektrik dibandingkan dengan Sistem Konvensional, telah dihasilkan. Pengiraan dilakukan dengan cara mempelbagaikan peratusan bekalan ais, penggunaan ke atas kapasiti penyejukan yang berbeza iaitu 500 RT, 1000 RT, 1500 RT, sama ada dengan aplikasi beban asas atau pun tidak, di samping pelbagai kadar tarif yang dikenakan. Hasil kajian menunjukkan bahawa penggunaan Penyimpanan Tenaga Haba dalam peratusan yang terkecil adalah paling memberangsangkan dari segi tempoh pulangan balik dan penggunaan elektrik. Walaubagaimanapun, jumlah penjimatan adalah kecil. Keburukan sistem ini juga didapati dari segi guna tenaga, disebabkan proses membuat ais berlaku pada suhu yang rendah. Berhubung dengan kadar tarif pula, julat yang dapat diterima bagi aplikasi dengan beban asas dan peratusan bekalan ais telah dikenalpasti di mana sebahagian besar kadar tariff dengan aplikasi tiada beban asas berjaya mendapat tempoh pulangan balik kurang dari lima tahun. Parameter di mana Sistem Penyejukan Daerah dan Penyimpanan Tenaga Haba adalah tidak menguntungkan, juga dapat dipastikan.

ACKNOWLEDGEMENTS

The greatest appreciation goes to all my supervisors, Dr. Megat Hamdan Megat Ahmad, Dr. Hj. Sapuan Salit, Dr. Nor Mariah Adam, Dr. Abul Hossain, Ir. Hj. Fuad Abas and Ir. Hj. Mohd. Rasid Osman for their guidance, motivation and allocation of their precious time in order for me to complete this study.

I would also like to thank the staffs of Ministry of Science, Technology and Environment, especially Cik Nordiana Idris for their support throughout the whole period.

My gratitude also goes to all the directors of Jurutera CMP Sdn. Bhd., especially Ir. Arul Hisham Abd. Rahim for his willingness to share the knowledge on the topic of my research.

To those who have made contributions. I pray that Allah's blessing is rendered to you and your family.

Thank you.

I certify that an Examination Committee met on 6th November 2002 to conduct the final examination of Amir Ihsan Abd. Salam on his Master of Science thesis entitled “Development of Simulation Program for Thermal Energy Storage Integrated District Cooling System” in accordance with Universiti Pertanian Malaysia (Higher Degree) Act 1980 and Universiti Pertanian Malaysia (Higher Degree) Regulations 1981. The Committee recommends that the candidate be awarded the relevant degree. Members of the Examination Committee are as follows:

Hasan Yudie Sastra, Ph.D

Faculty of Engineering,
Universiti Putra Malaysia.
(Chairman)

Megat Hamdan Megat Ahmad, Ph.D

Associate Professor,
Faculty of Engineering,
Universiti Putra Malaysia.
(Member)

Tuan Haji Mohd. Sapuan Salit, Ph.D

Associate Professor,
Faculty of Engineering,
Universiti Putra Malaysia.
(Member)

Nor Mariah Adam, Ph.D

Associate Professor,
Faculty of Engineering,
Universiti Putra Malaysia.
(Member)



SHAMSHER MOHAMAD RAMADILI, Ph.D.

Professor/Deputy Dean,
School of Graduate Studies,
Universiti Putra Malaysia.

Date: 13 MAR 2003

The thesis submitted to the Senate of Universiti Putra Malaysia has been accepted as fulfillment of the requirement for the degree of Master Science. The members of the Supervisory Committee are as follows:

Megat Hamdan Megat Ahmad, Ph.D

Associate Professor,
Faculty of Engineering,
Universiti Putra Malaysia.
(Chairperson)

Tuan Haji Mohd. Sapuan Salit, Ph.D

Associate Professor,
Faculty of Engineering,
Universiti Putra Malaysia.
(Member)

Nor Mariah Adam, Ph.D

Associate Professor,
Faculty of Engineering,
Universiti Putra Malaysia.
(Member)



AINI IDERIS, Ph.D.
Professor/Dean,
School of Graduate Studies,
Universiti Putra Malaysia.

Date: 09 MAY 2003

DECLARATION

I hereby declare that the thesis is based on my original work except for quotations and citations which have been duly acknowledged. I also declare that it has not been previously or concurrently submitted for any degree at UPM or other institutions.



Amir Ihsan Abd. Salam

Date : 12 MAR 2003

1
2
3
4
5

TABLE OF CONTENTS

	Page
DEDICATION.....	ii
ABSTRACT.....	iii
ABSTRAK.....	v
ACKNOWLEDGEMENTS.....	vii
APPROVAL SHEETS.....	viii
DECLARATION FORM.....	x
TABLE OF CONTENTS.....	xi
LIST OF TABLES.....	xiv
LIST OF FIGURES.....	xvi
LIST OF ABBREVIATIONS.....	xviii

CHAPTER

1	INTRODUCTION.....	1
	1.1 Background.....	1
	1.2 Energy Overview.....	5
	1.3 Problems of TES Integrated DCS.....	12
	1.4 Scope of Study.....	15
	1.5 Research Aim and Objectives.....	16
2	LITERATURE REVIEW.....	17
	2.1 District Cooling System (DCS).....	17
	2.1.1 History.....	17
	2.2 Thermal Energy Storage (TES).....	18
	2.2.1 History of Energy Storage.....	19
	2.2.2 Criteria for TES.....	20
	2.2.3 Ice Storage Devices/Technology.....	22
	2.3 Cooling Load.....	31
	2.4 Operation of Conventional System and DCS.....	36
	2.4.1 Operation of Conventional System.....	37
	2.4.2 Operation of Thermal Energy Storage Integrated System.....	38
	2.5 Overview of Some District Cooling Application in Malaysia.....	41
	2.5.1 Kuala Lumpur City Centre (KLCC).....	41
	2.5.2 Putrajaya.....	42
	2.5.3 Kuala Lumpur International Airport (KLIA).....	42
	2.5.4 Universiti Tenaga Nasional (Uniten).....	43
	2.5.5 Cyberjaya.....	44

2.6	Issues Pertaining District Cooling with Thermal Energy Storage.....	45
2.6.1	Benefits of District Cooling System.....	46
2.6.2	Disadvantages of District Cooling System.....	48
2.6.3	Benefits of Thermal Energy Storage.....	49
2.6.4	Major Setback on TES system.....	52
2.7	District Cooling from Environmental Perspective.....	53
2.8	Summary.....	59
3	METHODOLOGY.....	60
3.1	Basis of Research.....	60
3.2	Background of the Site.....	61
3.2.1	Function of the Building.....	61
3.2.2	Cooling Load.....	61
3.2.3	Initial Cost for Air Conditioning Apparatus.....	62
3.2.4	Equipment Details.....	63
3.2.5	Electrical Tariff Structure in which the Site Falls Into.....	63
3.3	Flow Chart.....	64
3.3.1	Payback Analysis.....	66
3.3.2	Design Criteria.....	67
3.3.3	Simulation Program.....	67
3.3.4	Comparison against Conventional System.....	68
4	SOFTWARE DEVELOPMENT.....	70
4.1	Introduction.....	70
4.2	Flow Chart.....	70
4.3	About the Spreadsheet.....	72
4.4	Validation of Software Results.....	74
5	RESULTS AND DISCUSSIONS.....	75
5.1	Introduction.....	75
5.1.1	Site A.....	75
5.1.2	Simulation Result for Site A.....	76
5.1.3	Result Summary for Site A – TES.....	82
5.1.4	Result Summary for Site A – Conventional.....	83
5.1.5	Comparison Summary.....	84
5.2	Parameters for Simulation.....	84
5.2.1	Maximum Cooling Requirement for 500 RT, 1000 RT, 1500 RT with and without Base Load Imposed.....	88
5.2.2	Capacity of 500 RT without Base Load.....	88
5.2.3	Capacity of 500 RT with Base Load.....	90

5.2.4	Capacity of 1000 RT without Base Load.....	92
5.2.5	Capacity of 1000 RT with Base Load.....	94
5.2.6	Capacity of 1500 RT without Base Load.....	95
5.2.7	Capacity of 1500 RT with Base Load.....	96
5.3	Situation Where Different Tariff Structure is Applied.....	98
5.4	Overall Results.....	103
6	CONCLUSIONS AND RECOMMENDATIONS.....	108
6.1	Conclusions.....	108
6.2	Recommendations.....	109
	REFERENCES.....	112
	APPENDICES.....	117
A.	SIMULATION OUTPUT.....	117
	500 RT Without Base Load.....	118
	500 RT With Base Load.....	130
	1000 RT Without Base Load.....	142
	1000 RT With Base Load.....	154
	1500 RT Without Base Load.....	166
	1500 RT With Base Load.....	178
	Tariff Rates.....	190
	1000 RT Without Base Load.....	190
	1000 RT With Base Load.....	203
B.	CONTRACTOR'S FIGURES.....	216
	VITA.....	219

LIST OF TABLES

Table	Description	Page
1.1	Final Demand for Energy by Sector (1985 – 1999)	6
1.2	Major Generators for National Grid	8
1.3	Structure for Special C2 Tariff	10
2.1	Summary of Primary Features of Thermal Storage Systems	31
2.2	Load Profile of Different System	33
5.1	Simulation Output for Site ‘A’ with TES	81
5.2	Simulation Output of ‘Theoretical Conventional System’ for Site ‘A’	82
5.3	Simulation Result for 500 RT Cooling Load Without Base Load	90
5.4	Simulation Result for 500 RT Cooling Load With Base Load	92
5.5	Simulation Result for 1000 RT Cooling Load Without Base Load	94
5.6	Simulation Result for 1000 RT Cooling Load With Base Load	95
5.7	Simulation Result for 1500 RT Cooling Load Without Base Load	97
5.8	Simulation Result for 500 RT Cooling Load With Base Load	98

5.9	Maximum Cooling Requirement of 1000 RT, With and Without Base Load on Different Tariff Rates for 50 % and 100 % TES Supply	100
5.10	Overall Result for Electricity Bill Saving and Increased Electricity Consumption	103
5.11	Overall Result for Payback Period	104

LIST OF FIGURES

Figure	Description	Page
1.1	TNB's System Demand Curve for Peninsular Malaysia	2
1.2	Energy Consumption in Typical Office Buildings	2
1.3	Energy Consumption in Educational Buildings	3
1.4	Energy Consumption in Hospitals	3
1.5	Energy Growth in Terms of Sales (1978 – 1998)	6
2.1	Dimpled Iceball	24
2.2	A Simplified Ice Slurry System	29
2.3	Typical Load Profile for Conventional System of Office Buildings in Tropical Countries	34
2.4	Ideal Load Profile for Chillers of TES System of Office Buildings	36
2.5	Load Profile for Chillers of TES System and Conventional System of Office Buildings	37
2.6	Sample Schematic of a Conventional District Cooling System	38
2.7	Sample Schematic of a TES Integrated District Cooling System	40
3.1	Flow of Methodology	66
4.1	Flow Chart for Software Development	71
5.1	Payback Period vs. Percentage of TES Supply for 500 RT	93
5.2	Payback Period vs. Percentage of TES Supply for 1000 RT	96

5.3	Payback Period vs. Percentage of TES Supply for 500 RT	99
5.4	Bill Saving vs. Tariff	101
5.5	Payback Period vs. Tariff	102
5.6	Graph 'Percentage of Bill Saving' vs. 'Capacity'	105
5.7	Graph 'Increased Electricity Consumption' vs. 'TES Supply'	106
5.8	Graph 'Overall Payback' vs. 'TES Supply'	107

LIST OF ABBREVIATIONS

Abbreviation	Description
AHU	Air Handling Unit
CEPSI	Conference of Electricity and Power Supply Industry
CHW	Chilled Water
DCS	District Cooling System
DSM	Demand Side Management
EG	Ethylene Glycol
FFDS	Four Fuel Diversification Strategy
HDPE	High Density Poly Ethylene
lkW/rt	Input Kilowatt per Refrigerant Ton
IPP	Independent Power Producer
KLCC	Kuala Lumpur City Centre
KLIA	Kuala Lumpur International Airport
KWh	Kilowatt Hour (10^3)
KWr	Kilowatt refrigerant
lb/hr	Pound per Hour
L/s	Liter per second
MEC	Malaysian Energy Center
MmBtu	Million British Thermal Unit
MP	Malaysian Plan
MW	Megawatts
MWh	Mega Watt Hour (10^6)
PETRONAS	Petroleum Nasional Berhad
PG	Propylene Glycol
RM	Ringgit Malaysia
RT	Refrigerant Ton
RTh	Refrigerant Ton Hour
SIRIM	Standard Industries Research Institute, Malaysia
TNB	Tenaga Nasional Berhad
TES	Thermal Energy Storage
TWh	Tetra Watt Hour (10^{12})
USD	U S Dollar
Usgpm	U S gallon per minute

CHAPTER 1

INTRODUCTION

1.1 Background

Demand for energy has become critical now than ever before. Most of the developing countries recorded energy growth each year of more than 10 %. At average, Asian countries require 30,000 MW of new generation of energy every year while total of the world demand increase as high as 90,000 MW annually (Jusoh, 1996). In Malaysia alone, the demand for electricity soars at the rate of 11% a year (Shamsuddin, 1996). With current capacity of about 13,000 MW and expected 19,000 MW of capacity required in year 2005 (Pua, et al., 1996), Tenaga Nasional Berhad (TNB), the national electricity provider, is rigorously taking steps in sustaining the economic growth with sufficient energy supply.

Report by Chua (2000) which, illustrate the electricity demand curve in Peninsular Malaysia as reflected in Figure 1.1, shows that the curve for electricity demand is somewhat similar to that of air conditioning load. Since conventional air conditioning system and apparatus contribute 60 % to 75 % of total electricity peak demand. as shown in Figures 1.2, 1.3 and 1.4, energy management is said best be achieved through proper arrangement of air conditioning utilization.

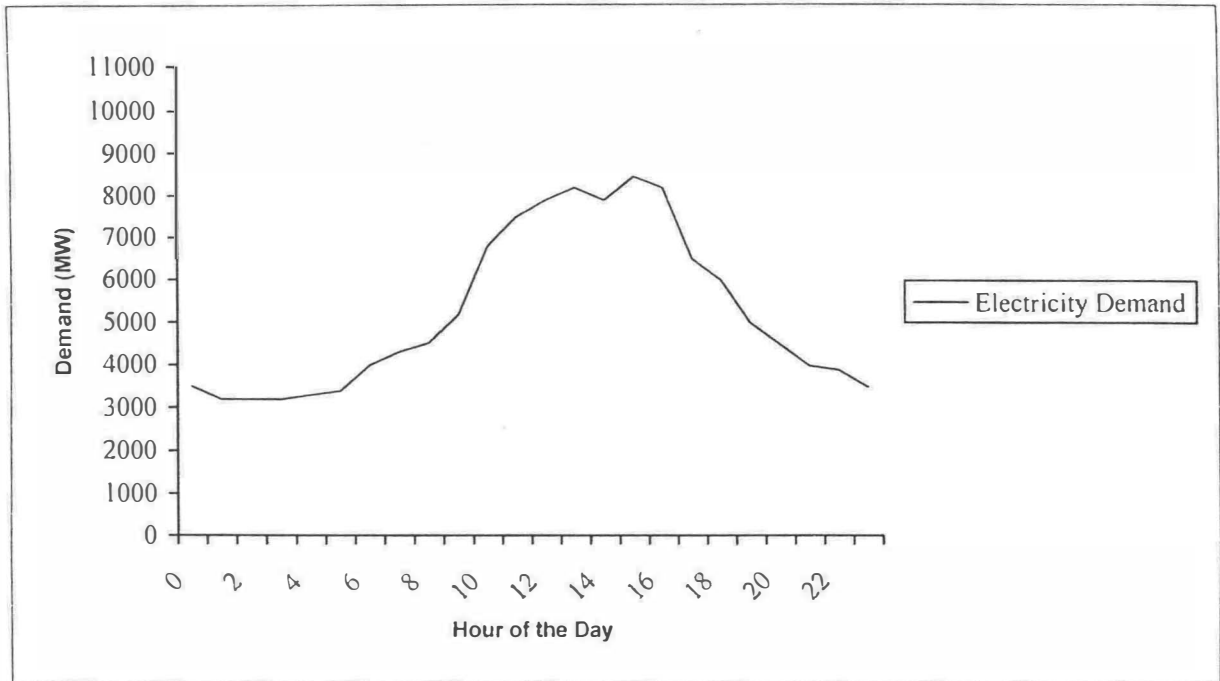


Figure 1.1: TNB's System Demand Curve for Peninsular Malaysia (Chua, 2000)

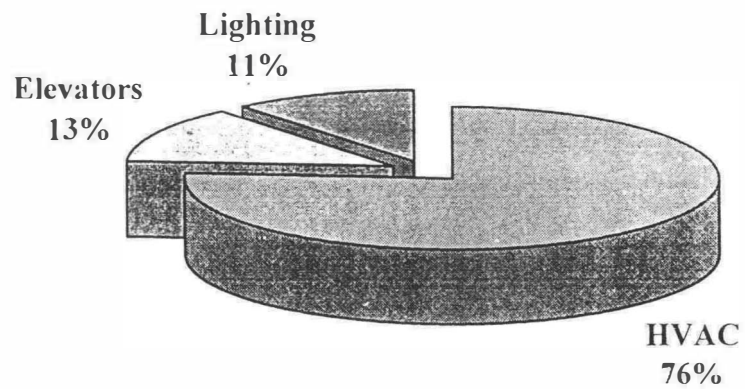


Figure 1.2: Energy Consumption in Typical Office Buildings (Thomas, 1997)

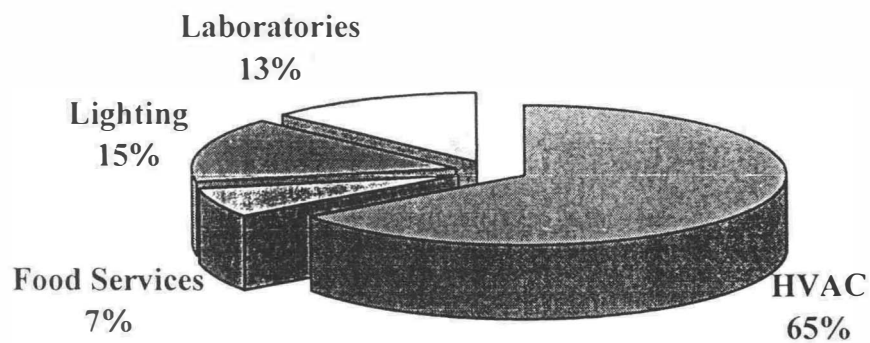


Figure 1.3: Energy Consumption in Educational Buildings (Thomas, 1997)

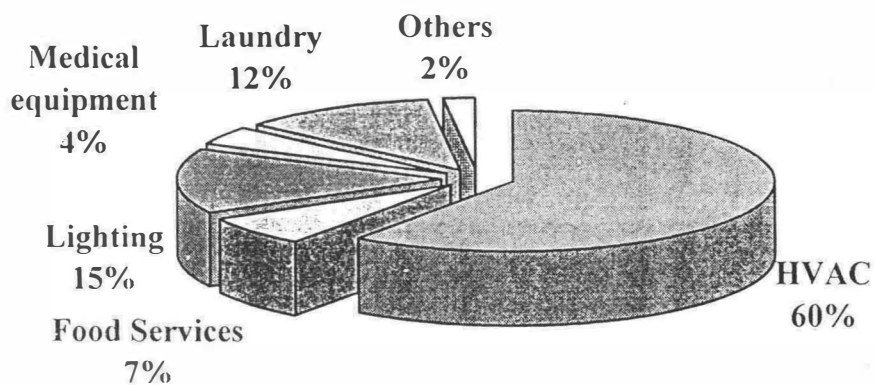


Figure 1.4: Energy Consumption in Hospitals (Thomas, 1997)

*Notes: HVAC – Heating, Ventilation and Air Conditioning

One major strategy to efficiently manage the imbalance energy utilization is to promote better customer participation through a program called Demand Side

Management (DSM)'. The program boasts an approach taken to reorganize the electricity utilization by reducing both peak and base electricity loadings. Thermal Energy Storage (TES) system, being part of DSM program, has been identified as a proven technology in electrical load management (Thomas, 1997).

Recent emergence of so-called 'Mega Projects' such as Kuala Lumpur International Airport (KLIA), Kuala Lumpur City Centre (KLCC), KL Sentral, Putrajaya and Cyberjaya have all participated in DSM program through application of TES technology with some implementation of District Cooling System (DCS). Depending on TES size, the contribution of TES application could reduce the electrical peak demand to as much as 20 % to 30 % (Rosli, et al., 1997).

1.2 Energy Overview

Being one of the fast growing developing nation in the region, Malaysia has been noted as one of the 'Asian Tigers' with its economic strength recognized globally. Before the economic turmoil during the period of 1997 to 1999, Malaysia has been experiencing strong economic growth at the average of 9 % for eight consecutive years (Mohamad, 1999), which in turn put the country through an unpredicted crisis of energy supply. The fact is, history of energy crisis in this country has dated back since 1973, when together with the rest of the world, faced with the famous oil crisis caused by the embargo of oil by Middle East Countries. From that date, a number of policies have been established by the Government to sustain the economic growth while maintaining sufficient supply of energy. Report released by Anon., Department of Statistic, Malaysia (1998), highlights that during the period of 1992 to 1998 alone, the production of natural gas has been increased by 115 % and crude oil by 10 %. While on the other hand, electrical power supply expanded up to 84 % (at annual rate of 11 %). The figure is significant as compared to the world growth of 2~3 %. The sales growth from 1978 to 1998 (20 years span) together with sales forecast until 2010 is illustrated in Figure 1.5 while sectional distribution of energy utilization and sectorised growth rate is shown in Table 1.1 for the fifth, Sixth, and Seventh Malaysia plans (MP5, MP6 and MP7).